

Report
On
Green Audit
At
Shri Shivaji Education Society, Amravati's
Dr. H. N. Sinha Arts & Commerce College
Patur , Dist – Akola
(Year 2021-22)



Prepared by
Nutan Urja Solutions
A 703, Balaji Witefield, Near Sunni's World,
Sus Road, Sus, Pune 411 021
Phone: 83568 18381. Email: nutanurja.solutions@gmail.com

Contents

Acknowledgement	2
Executive Summary	3
Abbreviations	5
1. Introduction.....	6
1.1 Objectives.....	6
1.2 Audit methodology.....	6
2. Building Survey	7
3. Study of Electrical Energy Consumption	10
4. Carbon Foot printing.....	12
5. Study of Rain Water Harvesting	14
6. Study of Waste Management.....	15
6.1 Solid Waste Management.....	15
6.2 e-Waste Management.....	15
7. Study of Green Practices.....	16
7.1 No of students who don't use own Vehicle for coming to Institute.....	16
7.2 Usage of Public Transport.....	16
7.3 Pedestrian Friendly Roads.....	16
7.4 Plastic Free Campus	16
7.5 Paperless Office.....	16
7.6 Green Landscaping with Trees and Plants	17

Acknowledgement

We at Nutan Urja Solutions, Pune, express our sincere gratitude to the management of Shri Shivaji Education Society, Amravati's Dr. H. N. Sinha Arts & Commerce College Patur , Dist - Akola for awarding us the assignment of Green Audit of their college premises.

We are also thankful to various Head of Departments & other Staff members for helping us during the field measurements.

We hope that the recommendations stated in this report will be useful and worthy of discussions to take things forward to help implementation of energy conservation measures and green practices. While we have made every attempt to adhere to high quality standards, in both data collection and analysis through the report, we would welcome your suggestions so as to improve upon this report further.

Executive Summary

Green Audit of Shri Shivaji Education Society, Amravati's Dr. H. N. Sinha Arts & Commerce College Patur , Dist - Akola is conducted by Nutan Urja Solutions, Pune. Based On the audit field study, following important points can be presented.

1. Present Energy Consumption

Shri Shivaji Education Society, Amravati's Dr. H. N. Sinha Arts & Commerce College Patur , Dist - Akola uses Electrical Energy as the source of Energy for various equipment in the college campus. In the following Table, we present the details of Energy Consumption.

Table no 1: Details of energy consumption

Sr no	Parameter	Energy consumed, (Units)	CO2 Emission (MT)
1	Maximum	897	0.72
2	Minimum	363	0.29
3	Average	560	0.45
4	Total	6,723	5.38

2. Various Measures Adopted for Energy Conservation

1. Usage of STAR Rated ACs at new installations
2. Usage of LED lights at some indoor locations
3. Usage of LED Lights for outdoor lighting.

3. Usage of Renewable Energy

The collage has installed 2 nos of Solar PV street lights.

4. Rain Water Harvesting

The College has installed the Rainwater harvesting project, to reduce dependency on municipal corporation water supply.

5. Waste Management

The College has already installed a Bio composting Plant, wherein, the bio-degradable waste is composted & is used as fertilizer for the garden.

The internal communication is through emails and there is hardly any generation of e-Waste in the premises.

6. Notes and Assumptions

1. Daily working hours-10 Nos
2. Annual working Days-250 Nos
3. Average Rate of Electrical Energy : **Rs 11/- per kWh**

Abbreviations

CFL	:	Compact Fluorescent Lamp
FTL	:	Fluorescent Tube Light
LED	:	Light Emitting Diode
V	:	Voltage
I	:	Current
kW	:	Kilo- Watt
kWh	:	kilo-Watt Hour
kVA	:	Active Power

1. Introduction

Smt. Savitridevi Sinha in the memory of her husband Dr. H. N. Sinha established Arts & Commerce College at Patur under the Berar Education Society in 1966 for the educational development of the student from this area.

At the time of establishment there were 92 students for Arts & 45 students for commerce stream. It is one of the rural colleges run by Shri Shivaji Education Society. Students from 20 villeges adjoining Patur tahsil come to this college for education. These villages are located in the hilly area so most of them belong to B.C. & minority community. They attend college regularly in spite of communication hurdles. The college campus is located beside Akola washim highway. The college has its own building having 20 class rooms, commodious building and an eye pleasing Botanical garden.

1.1 Objectives

1. To study present level of Energy Consumption
2. To Study the present CO₂ emissions
3. To assess the various equipment/facilities from Energy efficiency aspect
4. To measure various Electrical parameters
5. To study Scope for usage of Renewable Energy
6. To study various measures to reduce the Energy Consumption

1.2 Audit methodology

1. Study of connected load
2. Study of various Electrical parameters
3. To prepare the Report with various Encon measures with payback analysis

2. Building Survey

Table 2.1: Area Statement of Campus

Sr. No.	Name of Building	Built up Area in Sq.M.	Size in Meters		Carpet Area in Sq.Mt.	Name of the Department
			Length	Width		
1	Block A	825.00				
	Ground Floor					
			7.80	4.00	31.20	Principal's office
			5.70	3.50	19.95	Guest room -1
			5.60	3.00	16.80	Guest room -2
			5.75	3.50	20.13	Principal's chamber
			7.25	5.70	41.33	IQAC office
			7.10	3.50	24.85	Office room -1
			4.90	4.00	19.60	Office room -2
			4.90	3.60	17.64	Store room
			5.85	2.80	16.38	Front Entry
			8.00	1.40	11.20	Passage Veramda
			12.30	7.00	86.10	Computer Room 7
			12.50	5.00	62.50	Computer Room 8
			7.10	2.60	18.46	Exam Room
			7.10	2.60	18.46	Room 10
			9.00	2.40	21.60	Library Entry
			6.00	2.80	16.80	Librarian Office
			5.20	3.40	17.68	Staff reading room
			7.10	5.90	41.89	Students reading room
			6.30	3.30	20.79	Comp exam reading room
	6.30	3.50	22.05	Stake room		
	12.30	5.00	61.50	General stake room 1		
	7.00	6.00	42.00	General stake room 2		
	2.80	1.70	4.76	Store room		

			10.30	10.80	111.24	Auto Tech MCVC
			6.00	3.80	22.80	Toilet and Urinary
	First Floor	754.00	2.60	4.15	10.79	Auditorium Entry
			22.20	7.30	162.06	Auditorium
			5.30	4.70	24.91	Passage Gallery
			22.20	1.00	22.20	Passage Gallery
			7.90	4.40	34.76	Room - 2
			6.30	4.40	27.72	Room - 1 English Research
			37.30	1.40	52.22	Gallery Passage
			12.00	7.10	85.20	Room - 4
			12.00	5.00	60.00	Construction Tech-MCVC
			12.00	7.10	85.20	Room - 5
			12.00	5.00	60.00	Accountancy-MCVC
			7.30	12.00	87.60	Room - 6
			7.30	5.20	37.96	Room Daware Sir
2	Block B Old Building					
	Ground Floor	990.00	6.10	6.10	37.21	Room 21
			6.10	6.10	37.21	Room 22
			5.10	3.10	15.81	Room 23
			6.20	4.60	28.52	Room 24
			6.20	4.50	27.90	Staff room
			4.50	2.20	9.90	Gents Tiolet
			26.60	4.50	119.70	Girls Room 1
			27.60	4.50	124.20	Girls Room 2
			76.20	3.20	243.84	Verandha Passage
3	Block C New Building					
	Ground Floor	608.00	5.10	5.80	29.58	Commerce Dept 28
			5.10	4.50	22.95	History Dept 29
			3.00	3.10	9.30	Marathi Dept 29 A

		4.60	4.50	20.70	Political Sci Dept 30
		4.70	4.50	21.15	English Dept 31
		4.60	4.50	20.70	Marathi Dept 32
		3.90	4.40	17.16	NSS Dept
		2.00	4.40	8.80	Passage
		4.50	3.70	16.65	Internal room
		5.10	3.00	15.30	Internal room
		4.00	3.00	12.00	Lavatory Block
		9.30	7.30	67.89	Passage Store
		7.20	4.60	33.12	Recreation Hall 102
		5.00	6.40	32.00	Music 103
		24.50	3.00	73.50	Passage
		9.50	5.00	47.50	Chemistry PG 104
		9.50	5.00	47.50	Chemistry UG 105
		8.00	5.00	40.00	Chemistry extra
		4.00	3.50	14.00	Lavatory Block
		4.40	3.00	13.20	Passage
	First Floor	608.00			
		9.40	5.30	49.82	Botony Dept 201
		9.20	7.20	66.24	Passage
		9.40	5.30	49.82	EVS Dept 202
		9.40	5.30	49.82	Zoolgy Dept 203
		9.40	5.60	52.64	Electronics Dept 204
		9.40	5.30	49.82	Physics Dept 205
		14.20	5.10	72.42	Maths Dept 206
		22.40	2.00	44.80	Porch Passage
		6.20	7.70	47.74	Lavatory Block
		4.40	9.10	40.04	Lavatory Block
		4.60	5.10	23.46	Store room
		3.00	6.30	18.90	Stair case

3. Study of Electrical Energy Consumption

In this chapter, electricity bills are studied for the analysis of electrical energy consumption.

Table no 3.1: Summary of electricity bills

No	Month	Energy (kWh)	Bill Amount (Rs)
1	Jun-22	808	7286
2	May-22	864	6974
3	Apr-22	897	64730
4	Mar-22	591	4155
5	Feb-22	480	3373
6	Jan-22	366	2760
7	Dec-21	444	3148
8	Nov-21	374	2716
9	Oct-21	363	2766
10	Sep-21	464	3273
11	Aug-21	560	3873
12	Jul-21	512	3573
	Total	6,723	108,627

Variation in energy consumption is as follows,

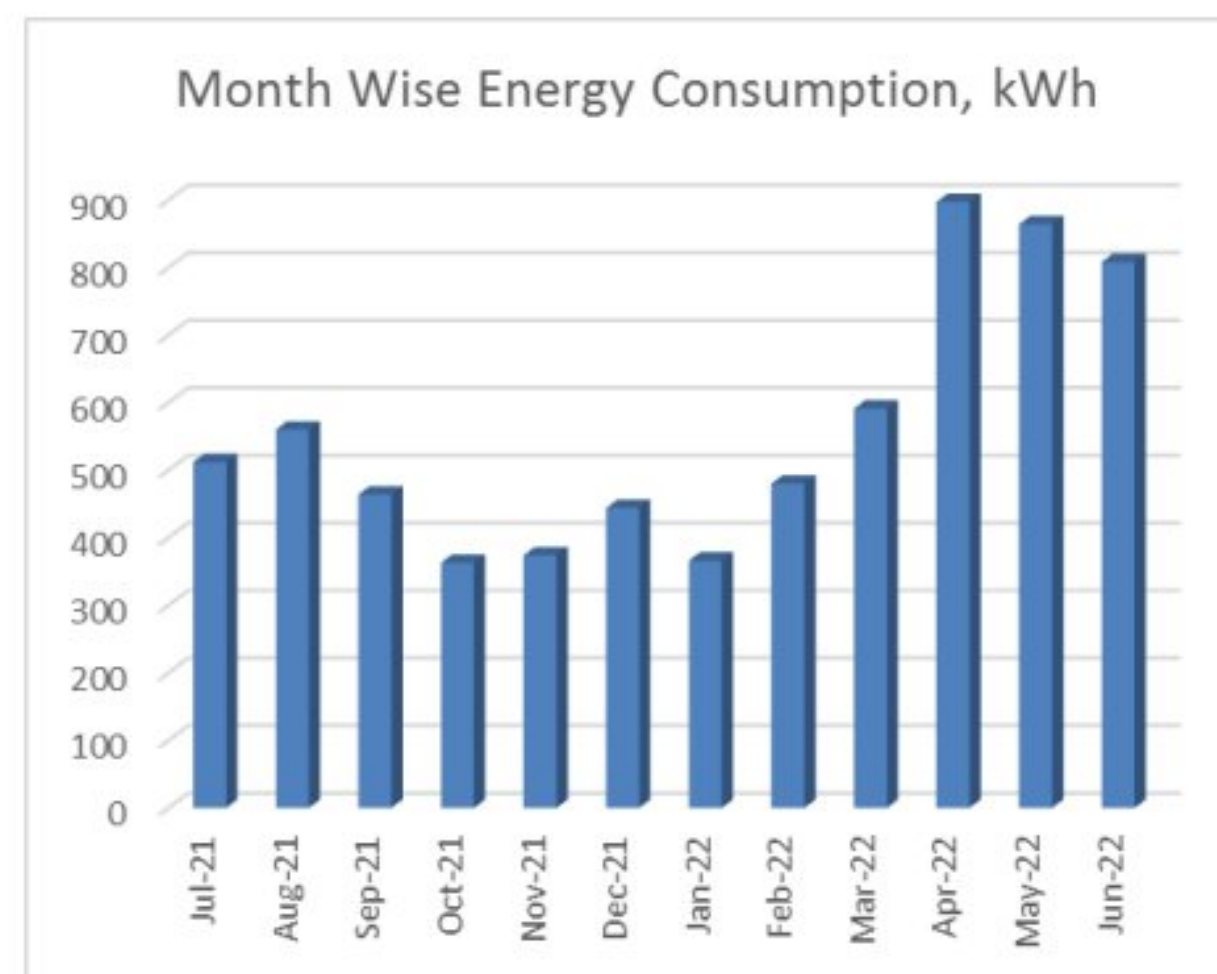


Figure 3.1: Month wise energy consumption

Monthly variation in electricity bill is as follows,

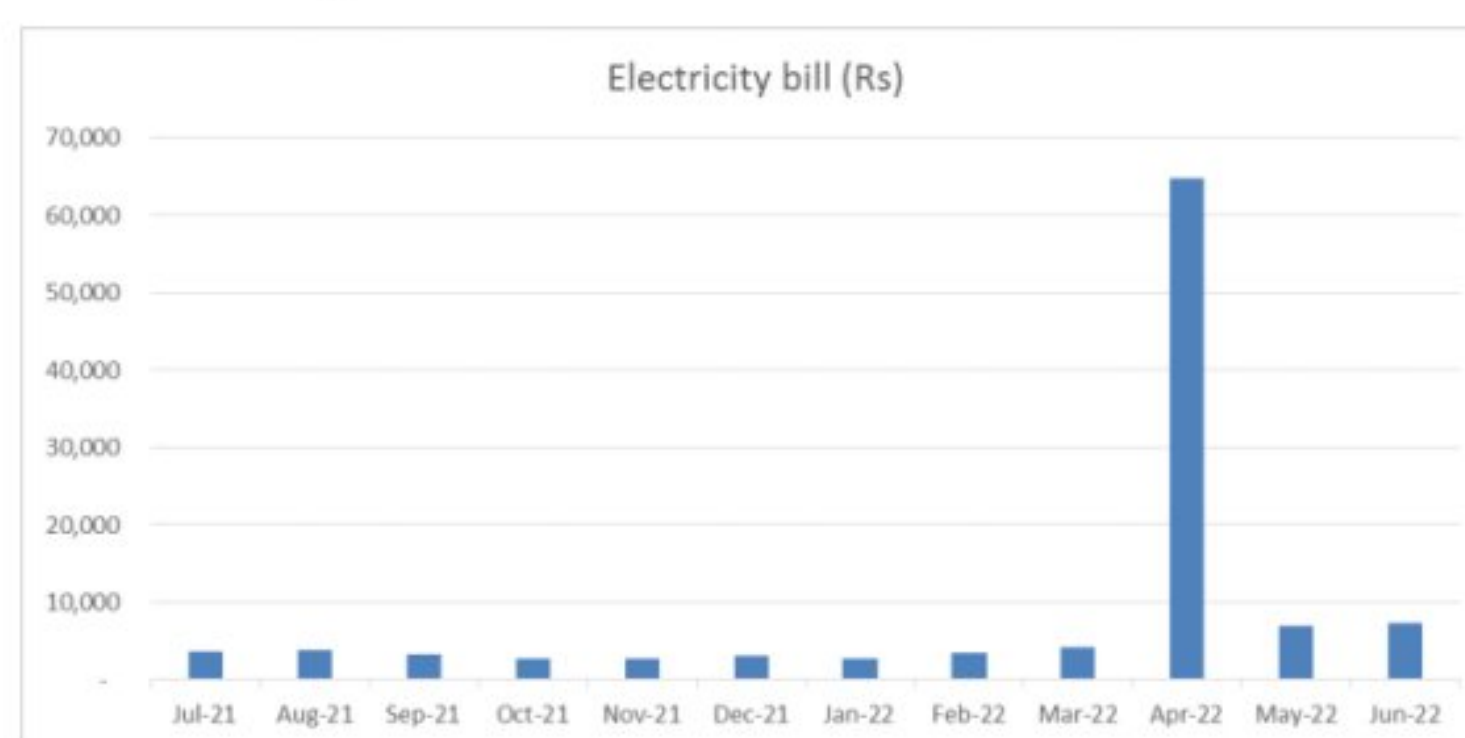


Figure 3.2: Month wise electricity bill

Key observations of electricity bill are as follows,

Table no 3.2: Key observations

Sr no	Parameter	Energy consumed, (Units)	CO2 Emission (MT)
1	Maximum	897	0.72
2	Minimum	363	0.29
3	Average	560	0.45
4	Total	6,723	5.38

4. Carbon Foot printing

1. A Carbon Foot print is defined as the Total Greenhouse Gas emissions (CO₂ emissions), emitted due to various activities. In this we compute the emissions of Carbon-Di-Oxide, by usage of the various form of Electrical Energy used by the College for performing its day to day activities

2. Basis for computation of CO₂ Emissions:

The basis of Calculation for CO₂ emissions due to Electrical Energy is as under

- 1 Unit (kWh) of Electrical Energy releases **0.8 Kg of CO₂** into atmosphere.

Based on the above Data we compute the CO₂ emissions which are being released in to the atmosphere by the College due to its Day to Day operations

We herewith furnish the details of various forms of Energy consumption as under

Table 4.1: Month wise Consumption of Electrical Energy & CO₂ Emissions

No	Month	Energy Consumed, kWh	CO ₂ Emissions, MT
1	Jun-22	808	0.65
2	May-22	864	0.69
3	Apr-22	897	0.72
4	Mar-22	591	0.47
5	Feb-22	480	0.38
6	Jan-22	366	0.29
7	Dec-21	444	0.36
8	Nov-21	374	0.30
9	Oct-21	363	0.29
10	Sep-21	464	0.37
11	Aug-21	560	0.45
12	Jul-21	512	0.41
	Total	6,723	5.38

In the following Chart we present the CO₂ emissions due to usage of Electrical Energy.

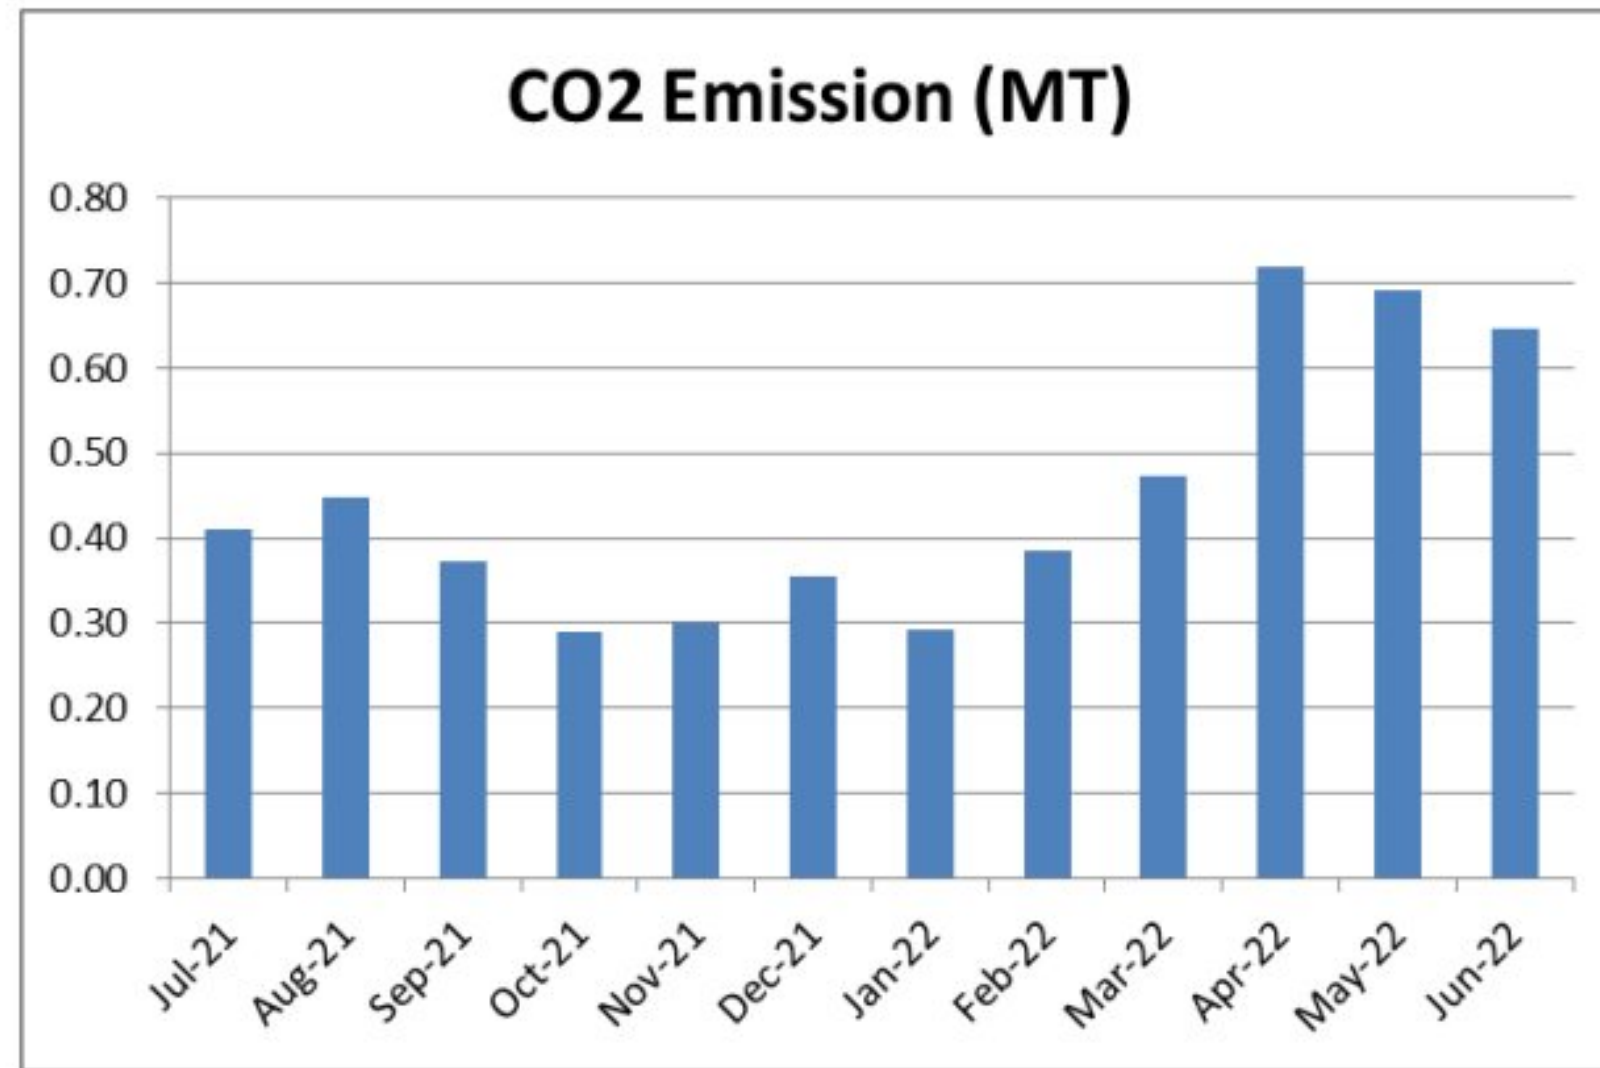


Figure 3.1: Month wise CO2 Emission

5. Study of Rain Water Harvesting

The College has already installed Rain Water Harvesting project, wherein the rain water falling on the terrace is collected and through pipes it is fed to underground Water Storage tank. This stored water is then reused for domestic purpose.

Photograph of Rain Water Harvesting pipe

6. Study of Waste Management

6.1 Solid Waste Management

The College has already installed a Bio composting Plant, wherein, the bio-degradable waste is composted & is used as fertilizer for the garden.

Photographs of Bio Composting Storage Tanks:

6.2 e-Waste Management

The internal communication is through emails and there is hardly any generation of e-Waste in the premises.

7. Study of Green Practices

7.1 No of students who don't use own Vehicle for coming to Institute

Out of total students coming to Institute, about 60% students use own Automobile.

7.2 Usage of Public Transport

During the Students transport study, it was revealed that the local students who are residing near areas make use of Public Transport like Municipal Transport local buses, local sharing type auto rickshaws. Some students use bicycles. Institute encourages students to not to use automobiles.

7.3 Pedestrian Friendly Roads

The Institute has well defined pedestrian foot paths as to facilitate the easy movement of the students within the campus.

Photograph of Road within campus



7.4 Plastic Free Campus

The Institute is an active participant in the Government of India's most prestigious project of SWATCHH BHART ABHIYAN. The Institute has displayed boards in the Campus, to make the campus plastic free. Various measures adopted for this purpose are as follows

- Installation of Separate waste bins for Dry waste & wet waste
- Usage of paper tea cups in the Institute canteen
- Display of boards in the campus for Plastic Free campus

7.5 Paperless Office

The internal communication of the Institute is through the Internet. There are hardly any day to day operations, where printing is required.

7.6 Green Landscaping with Trees and Plants

The Institute has beautiful maintained Garden.



Figure 7.1: Beautiful maintained Garden of college

Report
On
Energy Audit
At
Shri Shivaji Education Society, Amravati's
Dr. H. N. Sinha Arts & Commerce College
Patur , Dist – Akola
(Year 2021-22)



Prepared by
Nutan Urja Solutions
A 703, Balaji Witefield, Near Sunni's World,
Sus Road, Sus, Pune 411 021
Phone: 83568 18381. Email: nutanurja.solutions@gmail.com

Contents

Acknowledgement	2
Executive Summary	3
Abbreviations	5
1. Introduction.....	6
1.1 Objectives.....	6
1.2 Audit Methodology:	6
1.3 General Details of College	7
2. Study of connected load.....	8
3. Study of Electrical Energy Consumption	10
4. Carbon Foot printing.....	12
5. Study of utilities.....	14
5.1 Study of Lighting	14
5.2 Air-conditioners	14
5.3 Ceiling Fans.....	14
5.4 Water Pumps	14
6. Study of usage of LED lighting	15
7. Energy conservation proposals	16
7.1 Replacement of old fans with STAR Rated fans.....	16
7.2 Installation of Solar PV panel	17
7.3 Summary of Savings	18

Acknowledgement

We at Nutan Urja Solutions, Pune, express our sincere gratitude to the management of Shri Shivaji Education Society, Amravati's Dr. H. N. Sinha Arts & Commerce College, Patur , Dist - Akola for awarding us the assignment of Energy Audit of their college premises.

We are also thankful to various Head of Departments & other Staff members for helping us during the field measurements.

We hope that the recommendations stated in this report will be useful and worthy of discussions to take things forward to help implementation of energy conservation measures through energy savings. While we have made every attempt to adhere to high quality standards, in both data collection and analysis through the report, we would welcome your suggestions so as to improve upon this report further.

Executive Summary

After the Field measurements & analysis, we present herewith important observations made and various measures to reduce the Energy Consumption & mitigate the CO₂ emissions. College consumes Energy in the form of Electrical Energy used for various gadgets, Office & other facilities.

1. Present Energy Consumption

In the following Table, we present the details of Energy Consumption.

Table no 2.1: Details of energy consumption

Sr no	Parameter	Energy consumed, (Units)	CO ₂ Emission (MT)
1	Maximum	897	0.72
2	Minimum	363	0.29
3	Average	560	0.45
4	Total	6,723	5.38

2. Energy Conservation Projects already installed

1. Usage of STAR Rated ACs
2. Usage of LED lights at indoor locations
3. Usage of LED Lights for outdoor lighting.

3. Key Observations

1. Usage of LED lights.
2. Usage of star rated equipment.
3. Maintained a good power factor.

4. Usage of Alternate Energy

The College has installed 2 nos of solar PV LED street lights.

5. Percentage of Usage of LED Lighting

The College has various Types of Light fittings. The percentage of Annual LED Lighting Usage to Annual Lighting requirement works out to be 100 %.

6. Recommendations

Table no 1: Recommendations for energy savings

No	Recommendation	Annual Saving potential, kWh/Annum	Annual Monetary Gain, Rs.	Investment Required, Rs.	Payback period, Months
1	Replacement of 40 Nos Old Ceiling Fans with STAR rating fans	520	5,720	86,960	182
2	Installation of 5kW grid connected PV panel	7,500	82,500	250,000	36
	Total	8,020	88,220	336,960	46

7 Notes & Assumptions

1. Daily working hours-10 Nos
2. Annual working Days-300 Nos
3. Average Rate of Electrical Energy : **Rs 11/- per kWh**

Abbreviations

CFL	:	Compact Fluorescent Lamp
FTL	:	Fluorescent Tube Light
LED	:	Light Emitting Diode
V	:	Voltage
I	:	Current
kW	:	Kilo- Watt
kWh	:	kilo-Watt Hour
kVA	:	Active Power

1. Introduction

Smt. Savitridevi Sinha in the memory of her husband Dr. H. N. Sinha established Arts & Commerce College at Patur under the Berar Education Society in 1966 for the educational development of the student from this area.

At the time of establishment there were 92 students for Arts & 45 students for commerce stream. It is one of the rural colleges run by Shri Shivaji Education Society. Students from 20 villeges adjoining Patur tahsil come to this college for education. These villages are located in the hilly area so most of them belong to B.C. & minority community. They attend college regularly in spite of communication hurdles. The college campus is located beside Akola washim highway. The college has its own building having 20 class rooms, commodious building and an eye pleasing Botanical garden.

1.1 Objectives

1. To study present level of Energy Consumption
2. To Study Electrical Consumption
3. To assess the various equipment/facilities from Energy efficiency aspect
4. To study various measures to reduce the Energy Consumption

1.2 Audit Methodology:

1. Study of connected load
2. Study of various Electrical parameters
3. To prepare the Report with various Encon measures with payback analysis

1.3 General Details of College

Table No-1.1: Details of college

No	Head	Particulars
1	Name of Institution	Shri Shivaji Education Society, Amravati's Dr. H. N. Sinha Arts & Commerce College Patur , Dist - Akola
2	Address	Shri Shivaji Education Society, Amravati's Dr. H. N. Sinha Arts & Commerce College Patur , Dist - Akola Maharashtra 444 501.
3	Affiliation	Sant Gadge Baba Amravati University, Amravati.

2. Study of connected load

In this chapter, we present details of various connected electrical equipment and electrical load.

Table No-2.1: Location wise study of Electrical fittings in various buildings

No	Location	LED tube (20W)	LED bulb (12W)	Computers (65W)	Fans	1.5 Tr Star rated AC
1	Principal Office	4	1	1	2	1
2	IQAC office	2	1	1	2	1
3	Office	6	2	6	4	0
4	Class Rooms	18	3	0	18	0
5	Library Rooms	6	1	4	4	0
6	Computer labs	4	0	20	2	0
7	Departments	10	0	8	8	0
	Total	50	8	40	40	2

Apart from above load, the college has pumps, street lights. Individual fitting wise load is as under.

Table No 2.2: Equipment wise Connected Load

No	Equipment	Qty	Load, W/Unit	Load, kW
1	LED Tube-20W	50	20	1.0
2	LED bulb	12	12	0.1
3	Computers	40	65	2.6
4	Ceiling Fan	40	65	2.6
5	Pumps (2 nos 1HP)			1.5
	Total			4.1

Data can be represented in terms of PIE chart as under,

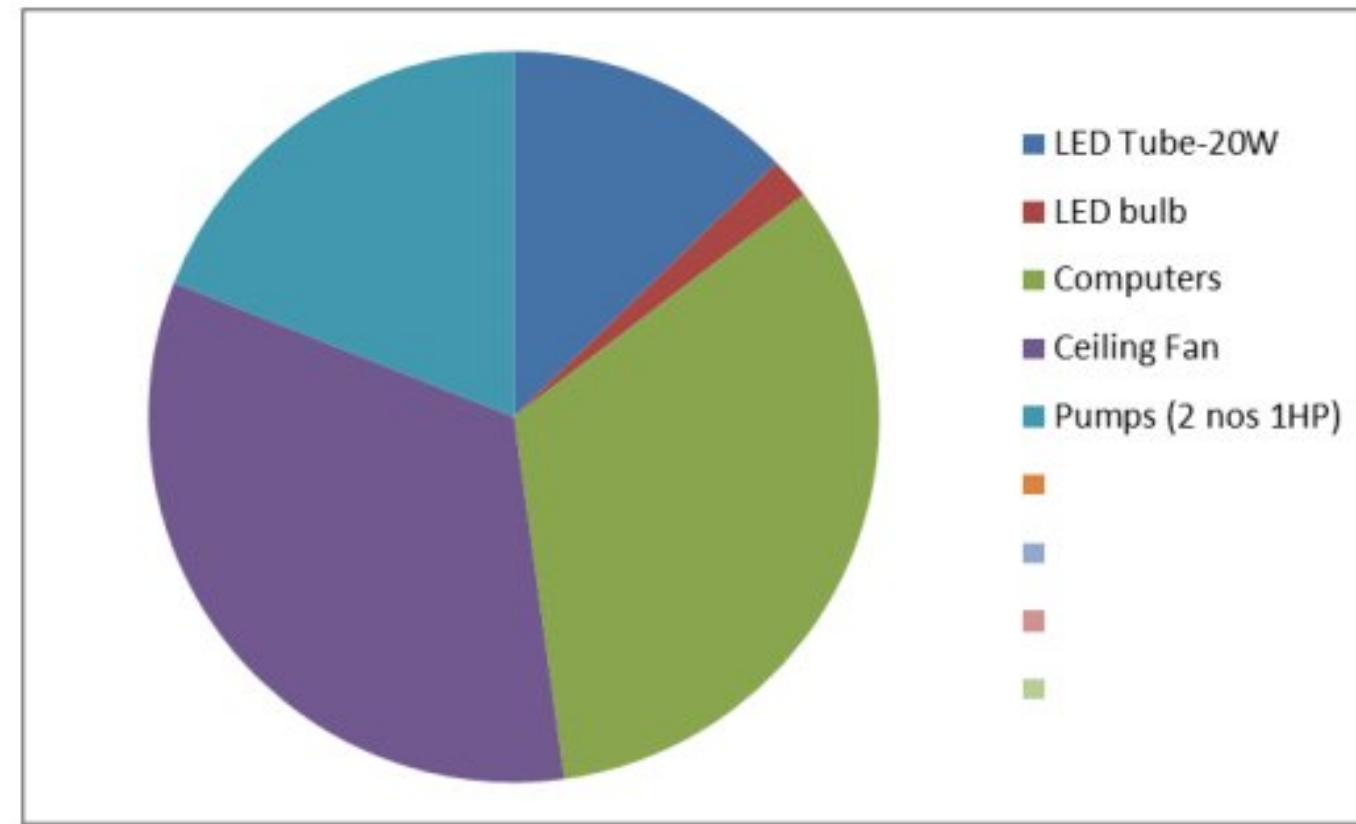


Figure 2.1: Distribution of connected load.

3. Study of Electrical Energy Consumption

In this chapter, electricity bills are studied for the analysis of electrical energy consumption.

Table no 3.1: Summary of electricity bills

No	Month	Energy (kWh)	Bill Amount (Rs)
1	Jun-22	808	7286
2	May-22	864	6974
3	Apr-22	897	64730
4	Mar-22	591	4155
5	Feb-22	480	3373
6	Jan-22	366	2760
7	Dec-21	444	3148
8	Nov-21	374	2716
9	Oct-21	363	2766
10	Sep-21	464	3273
11	Aug-21	560	3873
12	Jul-21	512	3573
	Total	6,723	108,627

Variation in energy consumption is as follows,

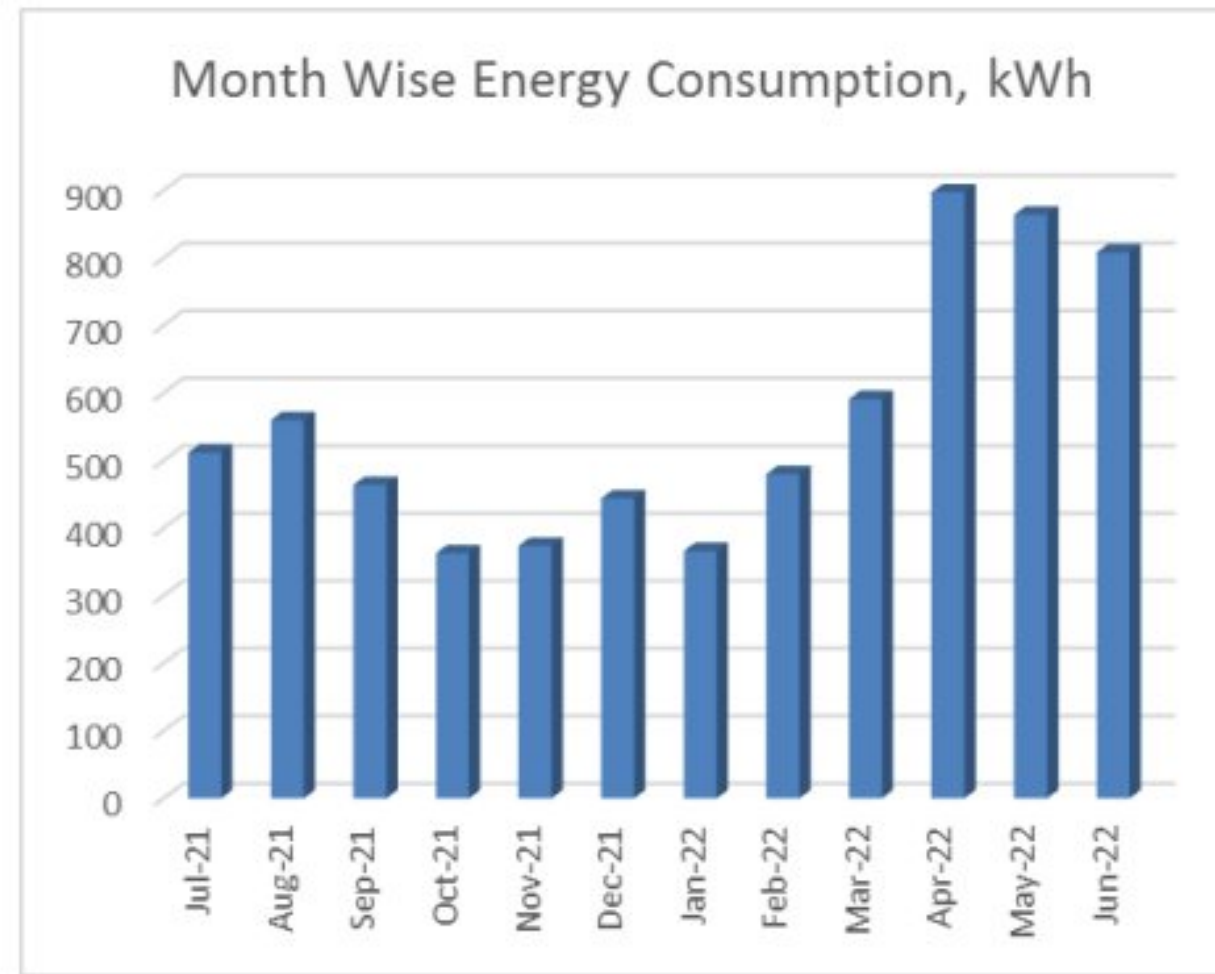


Figure 3.1: Month wise energy consumption

Monthly variation in electricity bill is as follows,

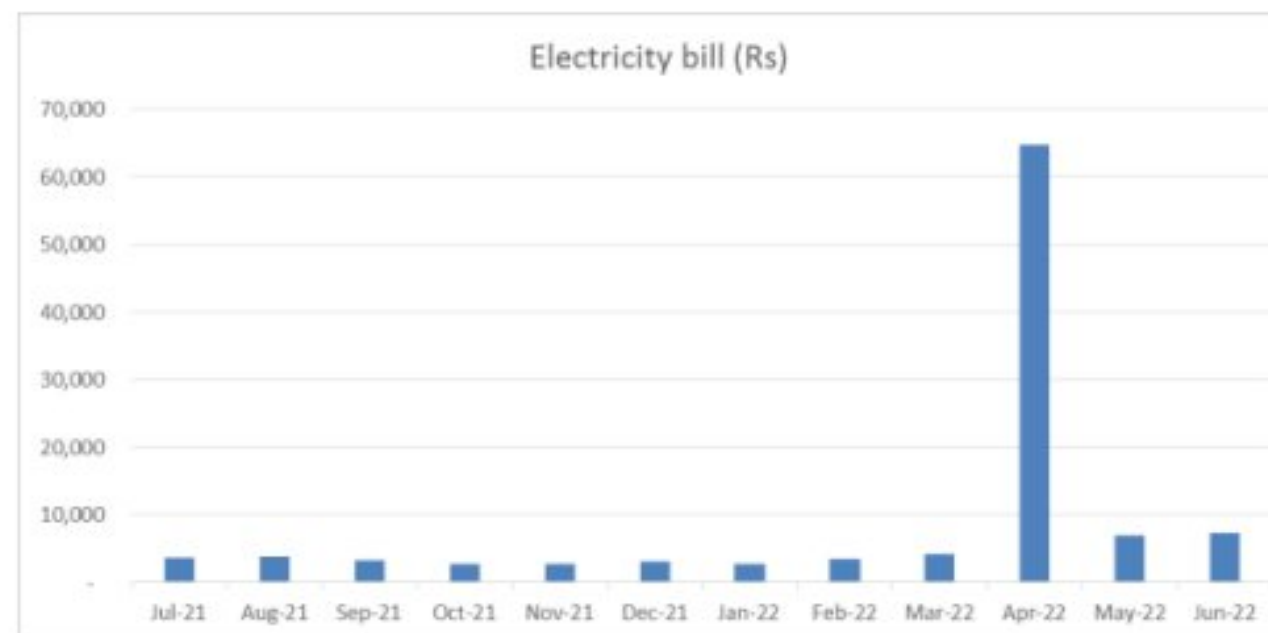


Figure 3.2: Month wise electricity bill

Key observations of electricity bill are as follows,

Table no 3.2: Key observations

Sr no	Parameter	Energy consumed, (Units)	CO2 Emission (MT)
1	Maximum	897	0.72
2	Minimum	363	0.29
3	Average	560	0.45
4	Total	6,723	5.38

4. Carbon Foot printing

1. A **Carbon Foot print** is defined as the Total Greenhouse Gas emissions (CO₂ emissions), emitted due to various activities. In this we compute the emissions of Carbon-Di-Oxide, by usage of the various form of Electrical Energy used by the College for performing its day to day activities

2. Basis for computation of CO₂ Emissions:

The basis of Calculation for CO₂ emissions due to Electrical Energy is as under

- 1 Unit (kWh) of Electrical Energy releases **0.8 Kg of CO₂** into atmosphere.

Based on the above Data we compute the CO₂ emissions which are being released in to the atmosphere by the College due to its Day to Day operations

We herewith furnish the details of various forms of Energy consumption as under

Table 4.1: Month wise Consumption of Electrical Energy & CO₂ Emissions

No	Month	Energy Consumed, kWh	CO ₂ Emissions, MT
1	Jun-22	808	0.65
2	May-22	864	0.69
3	Apr-22	897	0.72
4	Mar-22	591	0.47
5	Feb-22	480	0.38
6	Jan-22	366	0.29
7	Dec-21	444	0.36
8	Nov-21	374	0.30
9	Oct-21	363	0.29
10	Sep-21	464	0.37
11	Aug-21	560	0.45
12	Jul-21	512	0.41
	Total	6,723	5.38

In the following Chart we present the CO2 emissions due to usage of Electrical Energy.

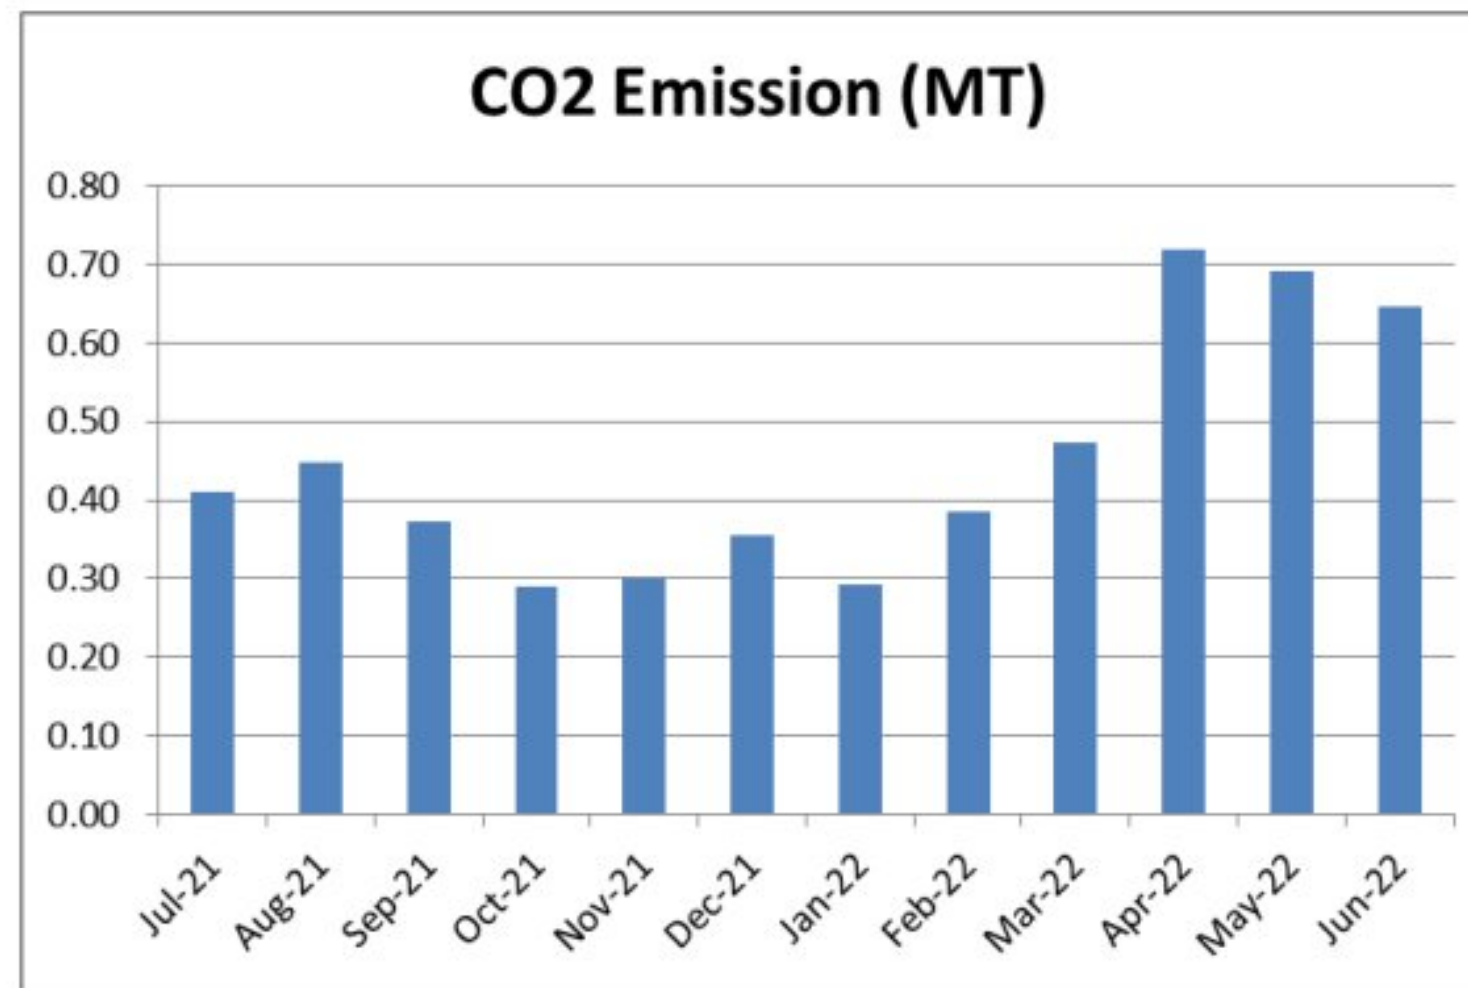


Figure 4.1: Month wise CO2 Emission

5. Study of utilities

5.1 Study of Lighting

In the facility, the lighting system can be divided mainly in to parts, indoor lighting and outdoor lighting. There are 21 nos of LED tubes, 55 nos of LED bulbs. There are 30 No of LED street lights.

5.2 Air-conditioners

There is 2 nos of star rated new AC of 1.5Tr capacity.

5.3 Ceiling Fans

At building facility, there are about 40 Nos of Old Ceiling Fans, which consumed about 65 W of Electrical Energy. It is recommended to replace these old Fans with BEE STAR Rated Ceiling Fans.

5.4 Water Pumps

There are in total 2 nos of Water pumps with 1HP capacities respectively.

6. Study of usage of LED lighting

In this chapter we study the lighting system of college and compute the percentage of total load catered by LED lighting.

Table 6.1: Total lighting load

No	Particulars	Qty	Load, W/Unit	Load, kW
	LED lighting load			
1	LED tube	50	20	1.00
2	LED bulbs	12	12	0.14
3	Solr Focus LED Street Lights	2	35	0.07
	Total LED lighting load			1.14
	Total Lighting load			1.14

It can be seen that out of total lighting load 100% load is LED lighting load.

7. Energy conservation proposals

7.1 Replacement of old fans with STAR Rated fans

During the Audit, it was observed that there are 40 no of fans. It is recommended to replace these old fans with STAR Rated fans.

In the following Table, we present the savings, investment required & payback analysis.

No	Particulars	Value	Unit
1	Present Qty of Old Ceiling Fan fittings	40	Nos
2	Energy Demand of Old Ceiling Fan fitting	65	W/Unit
3	Energy Demand of STAR Rated Fan	52	W/Unit
4	Reduction in demad	13	W/Unit
5	Average Daily Usage period	4	Hrs/Day
6	Daily saving in Energy	2.08	kWh/Day
7	Annual Working Days	250	Nos
8	Annual Energy Saving possible	520	kWh/Annum
9	Rate of Electrical Energy	11	Rs/kWh
10	Annual Monetary saving	5720	Rs/Annum
11	Cost of STAR Rated Ceiling Fan	2174	Rs/unit
12	Investment required	86960	Rs lump sum

7.2 Installation of Solar PV panel

It is recommended to install 5 kW solar PV panel. In the following Table, we present the savings, investment required & payback analysis.

No	Particulars	Value	Unit
1	Installation of 20kW PV unit	5	kW
2	Energy saving	7500	kWh/Annum
3	Rate of electrical energy	11	Rs
4	Annual monetary savings	82500	Rs/ Annum
5	Investment required	250000	Rs lump sum
6	Simple payback period	36	Months

7.3 Summary of Savings

No	Recommendation	Annual Saving potential, kWh/Annum	Annual Monetary Gain, Rs.	Investment Required, Rs.	Payback period, Months
1	Replacement of 40 Nos Old Ceiling Fans with STAR rating fans	520	5,720	86,960	182
2	Installation of 5kW grid connected PV panel	7,500	82,500	250,000	36
	Total	8,020	88,220	336,960	46

Report
On
Environmental Audit
At
Shri Shivaji Education Society, Amravati's
Dr. H. N. Sinha Arts & Commerce College
Patur , Dist - Akola



Prepared by
Nutan Urja Solutions
A 703, Balaji Witefield, Near Sunni's World,
Sus Road, Sus, Pune 411 021
Phone: 83568 18381. Email: nutanurja.solutions@gmail.com

Table of Contents

Acknowledgement	2
Executive Summary	3
Abbreviations	5
1. Introduction.....	6
1.1 Important Definitions:	6
1.2 Objectives.....	7
1.3 Audit Methodology:	7
1.4 General Details of College	8
2. Study of Consumption of Various Resources	10
2.1 Variation of Monthly Electrical Energy Consumption	11
2.2 Key Inference drawn	12
3. Study of Environmental Pollution	13
3.1 Air Pollution.....	13
3.2 Study of Solid Waste Generation	14
3.3 Study of Liquid Waste Generation.....	14
3.4 Study of e-Waste Management:	14
4. Study of Rain Water Harvesting	15
5. Recommendations.....	16

Acknowledgement

We at Nutan Urja Solutions, Pune wish to express our sincere gratitude to the management of Shri Shivaji Education Society, Amravati's Dr. H. N. Sinha Arts & Commerce College Patur , Dist - Akola for assigning the work of Environmental Audit of college campus.

We appreciate the co-operation and support extended to our team members during the entire tenure of field study.

We are also thankful to various Head of Departments & other Staff members for helping us during the field measurements.

We are also thankful to all other staff members who helped us during the Measurements at the field and for giving us the necessary inputs to carry out this vital exercise.

Executive Summary

After the Field measurements & analysis, we present herewith important observations made and various measures to reduce the dependency on Natural resources & reduce the pollution.

Shri Shivaji Education Society, Amravati's Dr. H. N. Sinha Arts & Commerce College Patur , Dist - Akola consumes various resources for day to day operations, namely: Air, Water, Electrical Energy & LPG.

1. Various Pollution due to College Activities:

- Air pollution: Mainly CO₂ on account of Electricity & LPG Consumption
- Solid Waste: Bio degradable Kitchen Waste, Garden Waste
- Liquid Waste: Human liquid waste

2. Present Level of CO₂ Emissions:

Sr no	Parameter	Energy consumed, (Units)	CO ₂ Emission (MT)
1	Maximum	897	0.72
2	Minimum	363	0.29
3	Average	560	0.45
4	Total	6,723	5.38

3. The various projects already implemented for Environmental Conservation:

- Usage of Energy Efficient BEE STAR Rated ACs
- Usage of Natural Day light in corridors
- Implementation of Bio Composting pit for disposal of Bio degradable waste
- Implementation of Rain Water Harvesting
- Installation of 2 nos of solar PV street lights

4. Recommendations:

1. Installation of Bio Gas Generator Plant instead of Bio composting Plant.
2. Installation of Sewage treatment Plant to make campus a Zero Discharge campus

5. Notes & Assumptions:

1. **1 kWh** of Electrical Energy releases **0.8 Kg of CO₂** into atmosphere
2. 1 kWp Solar PV plant generates 5 kWh/day Electrical Energy for 300 days in an year.

Abbreviations

AC	:	Air conditioner
PES	:	Progressive Education Society
CFL	:	Compact Fluorescent Lamp
FTL	:	Fluorescent Tube Light
LED	:	Light Emitting Diode
kWh	:	kilo-Watt Hour
Qty	:	Quantity
W	:	Watt
kW	:	Kilo Watt
PF	:	Power Factor
M D	:	Maximum Demand
PC	:	Personal Computer
MSEDCL	:	Maharashtra State Electricity Distribution Company Ltd

1. Introduction

1.1 Important Definitions:

1.1.1 Environment: Definition as per environment Protection Act: 1986

Environment includes water, air and land and the inter-relationship which exists among and between Water, Air, Land and Human beings, other living creatures, plants microorganism and property

1.1.2. Environmental Audit: Definition:

An audit which aims at verification and validation to ensure that various environmental laws are compiled with and adequate care has been taken towards environmental protection and preservation

According to UNEP, 1990, "Environmental audit can be defined as a management tool comprising systematic, documented and periodic evaluation of how well environmental organization management and equipment are performing with an aim of helping to regularize the environment"

1.1.3. Environmental Pollutant: means any solid, liquid and gaseous substance present in the concentration as may be, or tend to be, injurious to Environment.

1.1.4. Relevant Environmental Laws in India: Table No-1:

1927	The Indian Forest Act
1972	The Wildlife Protection Act
1974	The Water (Prevention and Control of Pollution) Act
1977	The Water (Prevention & Control of Pollution) Cess Act
1980	The Forest (Conservation) Act
1981	The Air (Prevention and Control of Pollution) Act
1986	The Environment Protection Act
1991	The Public Liability Insurance Act
2002	The Biological Diversity Act
2010	The National Green Tribunal Act

1.1.5. Some Important Environmental Rules in India: Table No-2:

1989	Hazardous Waste (Management and Handling) Rules
1989	Manufacture, Storage and Import of Hazardous Chemical Rules
2000	Municipal Solid Waste (Management and Handling) Rules
1998	The Biomedical Waste (Management and Handling) Rules
1999	The Environment (Siting for Industrial Projects) Rules
2000	Noise Pollution (Regulation and Control) Rules
2000	Ozone Depleting Substances (Regulation and Control) Rules

2011	E-waste (Management and Handling) Rules
2011	National Green Tribunal (Practices and Procedure) Rules
2011	Plastic Waste (Management and Handling) Rules

1.1.6 National Environmental Plans & Policy Documents: Table No-3:

1.	National Forest Policy, 1988
2.	National Water Policy, 2002
3.	National Environment Policy or NEP (2006)
4.	National Conservation Strategy and Policy Statement on Environment and Development, 1992
5.	Policy Statement for Abatement of Pollution (1992)
6.	National Action Plan on Climate Change
7.	Vision Statement on Environment and Human Health
8.	Technology Vision 2030 (The Energy Research Institute)
9.	Addressing Energy Security and Climate Change (MoEF and Bureau of Energy Efficiency)
10.	The Road to Copenhagen; India's Position on Climate Change Issues (MoEF)

1.2 Objectives

1. To study present usage of Natural resources the College is consuming
2. To Study the present pollution sources
3. To study various measures to make the campus Self sustainable in respect of Natural resources
4. To suggest the various measures to reduce the pollution: Air, Water, Noise

1.3 Audit Methodology:

1. Study of College as System
2. Study of Electrical Energy Consumption
3. Study of CO2 emissions
4. Suggestions on usage of Renewable Energy

1.4 General Details of College

No	Head	Particulars
1	Name of Institution	Shri Shivaji Education Society, Amravati's Dr. H. N. Sinha Arts & Commerce College Patur , Dist - Akola
2	Address	Shri Shivaji Education Society, Amravati's Dr. H. N. Sinha Arts & Commerce College Patur , Dist - Akola Maharashtra 444 501.
3	Affiliation	Sant Gadge Baba Amravati University, Amravati.

2. Study of Consumption of Various Resources


The Institute consumes following basic/derived Resources:

1. Air
2. Water
3. Electrical Energy
4. Liquefied Petroleum Gas

Also, college emits following pollutants to environment

1. Human Waste: Solid/ Liquid
2. Kitchen waste
3. Air pollution

We try to draw a schematic diagram for the College System & Environment as under.

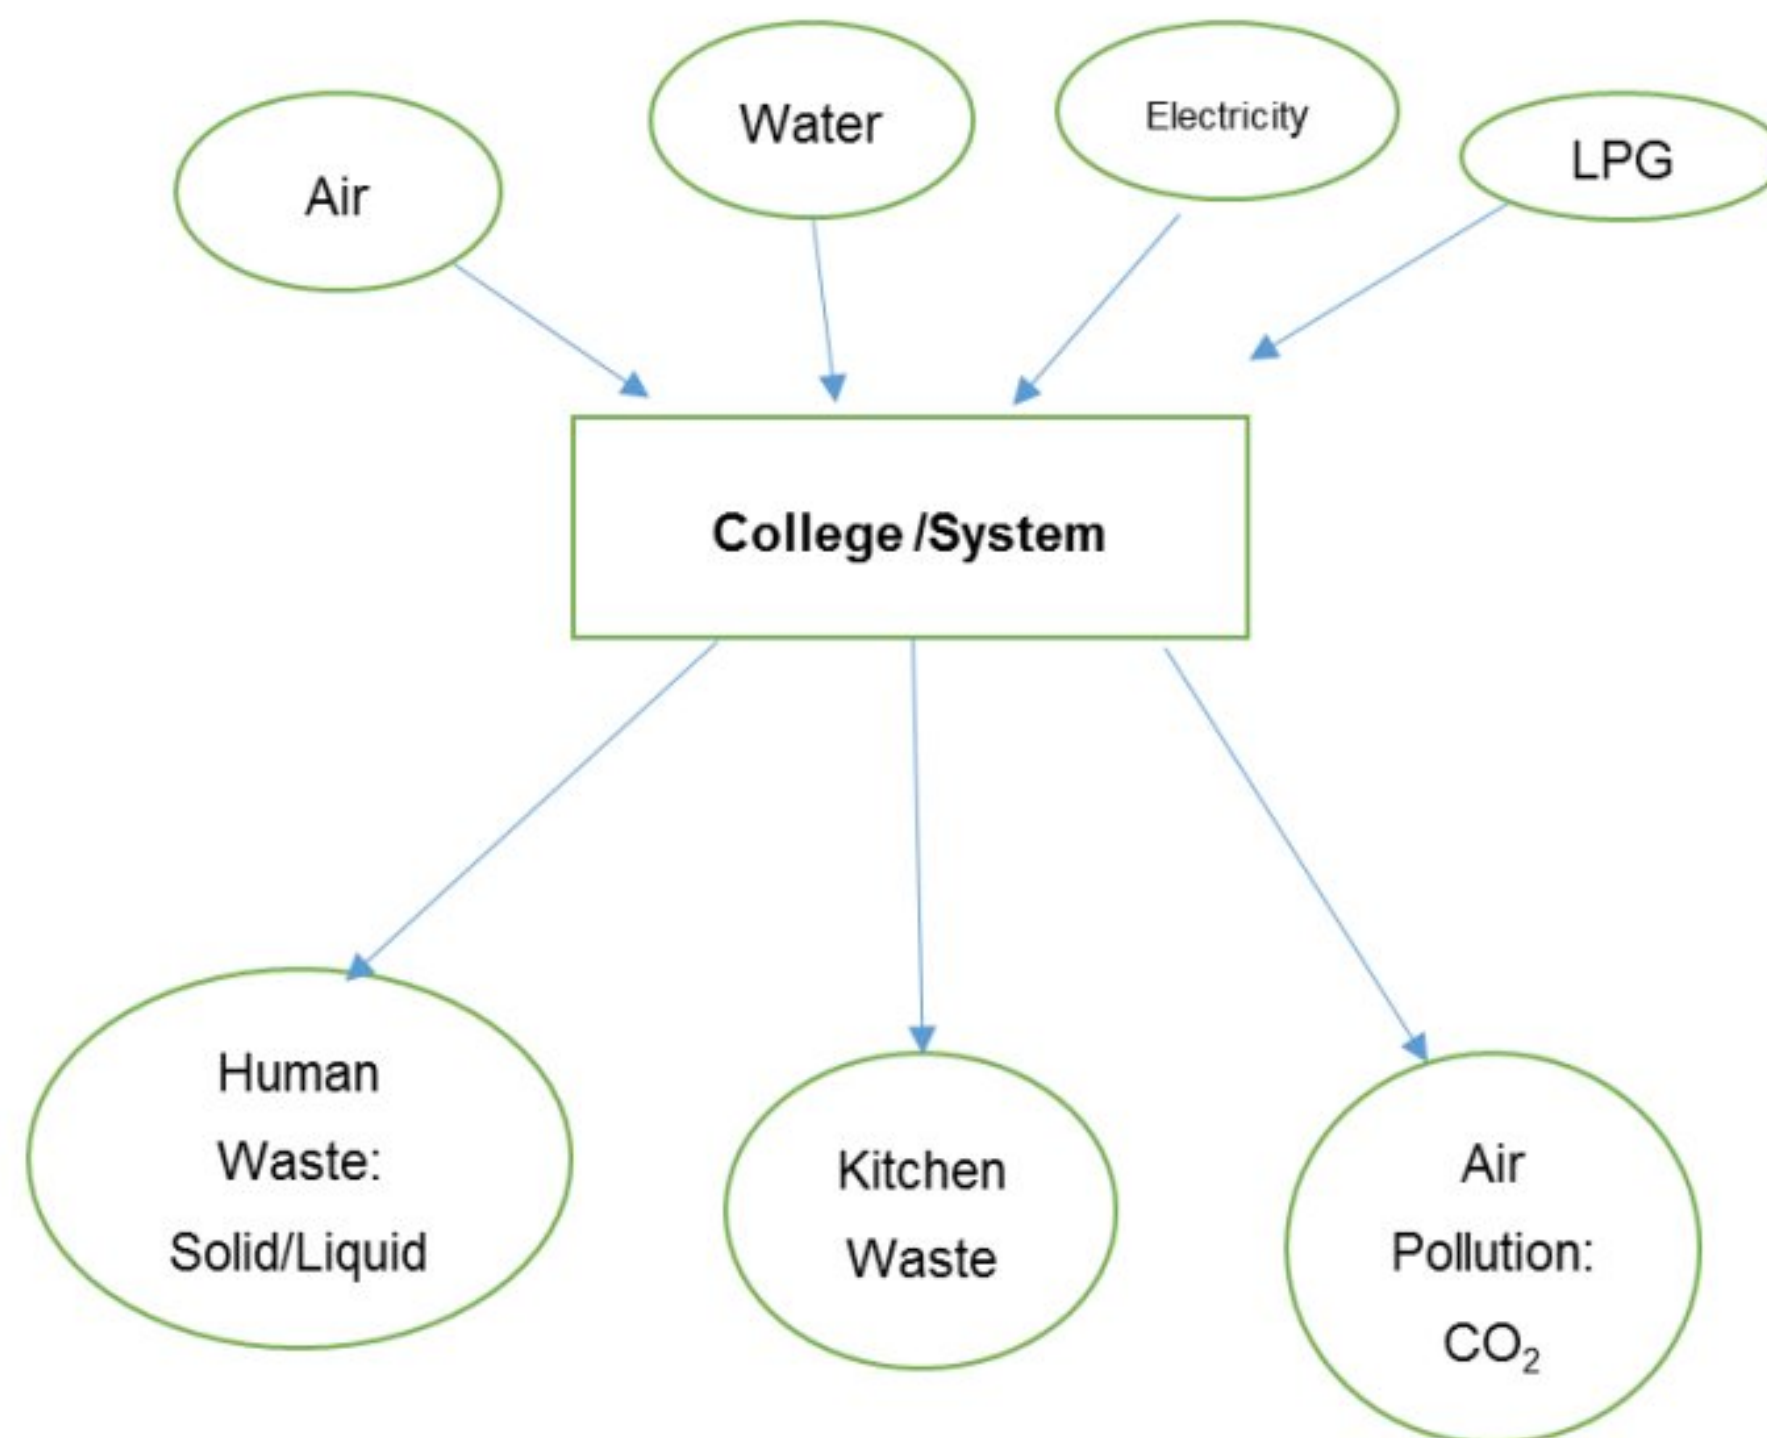

Now we compute the Generation of CO₂ on account of consumption of Electrical Energy & LPG as under.

The calculation of electrical energy consumption by college can be given as,

Table 2.1: Electrical Energy Consumption

No	Month	Energy (kWh)
1	Jun-22	808
2	May-22	864
3	Apr-22	897
4	Mar-22	591
5	Feb-22	480
6	Jan-22	366
7	Dec-21	444
8	Nov-21	374
9	Oct-21	363
10	Sep-21	464
11	Aug-21	560
12	Jul-21	512
	Total	6,723
	Maximum	897
	Minimum	363
	Average	560

2.1 Variation of Monthly Electrical Energy Consumption

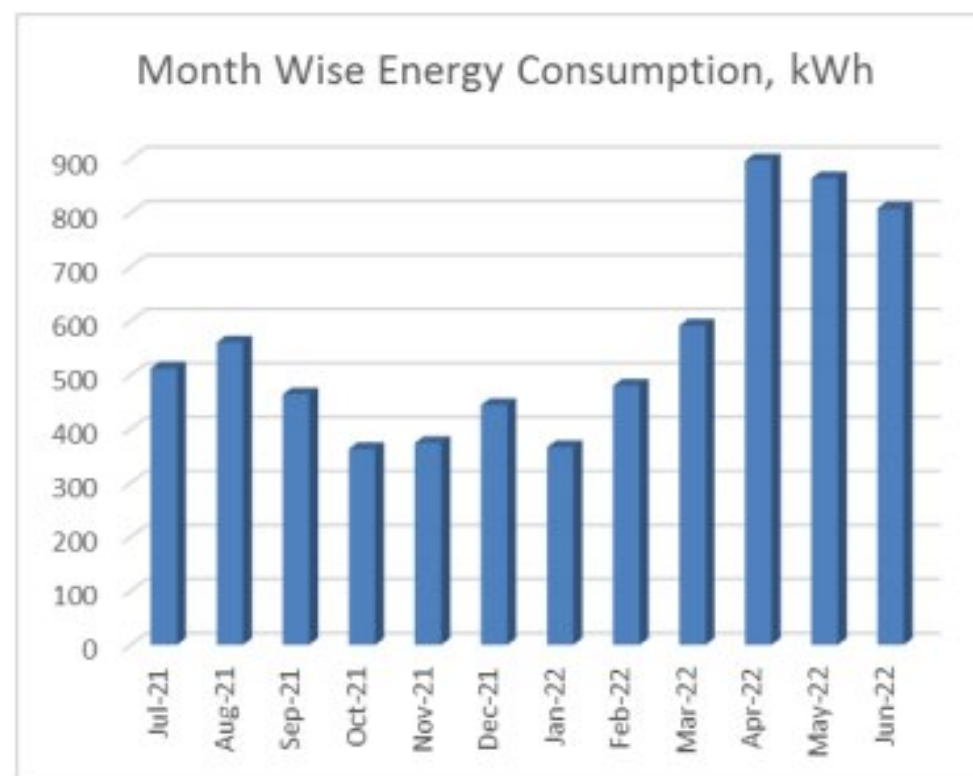


Figure 2.1 : Monthly Electrical Energy Consumption

2.2 Key Inference drawn

From the above analysis, we present following important parameters:

Table 2.2: Variation in Important Parameters

No	Parameter/ Value	Energy Consumed, kWh
1	Maximum	897
2	Minimum	363
3	Average	560
4	Total	6323

3. Study of Environmental Pollution

In this Chapter, we present the various types of Pollution as under:

3.1 Air Pollution

The College is using two forms of Energies, namely: Thermal in the form of LPG and Electrical Energy used for day to day operations of the College. The major pollutant on account of above Energy forms is the Carbon Di Oxide.

- 1 unit (kWh) of Electrical Energy emits 0.8 Kg of CO₂ in the atmosphere
- 1 Kg of LPG emits 3 Kg of CO₂ in the atmosphere

In the following Table, we present the CO₂ emissions.

Table 3.1: Month wise Consumption of Electrical Energy & CO₂ Emissions:

No	Month	Energy Consumed, kWh	CO ₂ Emissions, MT
1	Jun-22	808	0.65
2	May-22	864	0.69
3	Apr-22	897	0.72
4	Mar-22	591	0.47
5	Feb-22	480	0.38
6	Jan-22	366	0.29
7	Dec-21	444	0.36
8	Nov-21	374	0.30
9	Oct-21	363	0.29
10	Sep-21	464	0.37
11	Aug-21	560	0.45
12	Jul-21	512	0.41
	Total	6,723	5.38
	Maximum	897	0.72
	Minimum	363	0.29
	Average	560	0.45

In the following Chart we present the CO2 emissions due to usage of Electrical Energy.

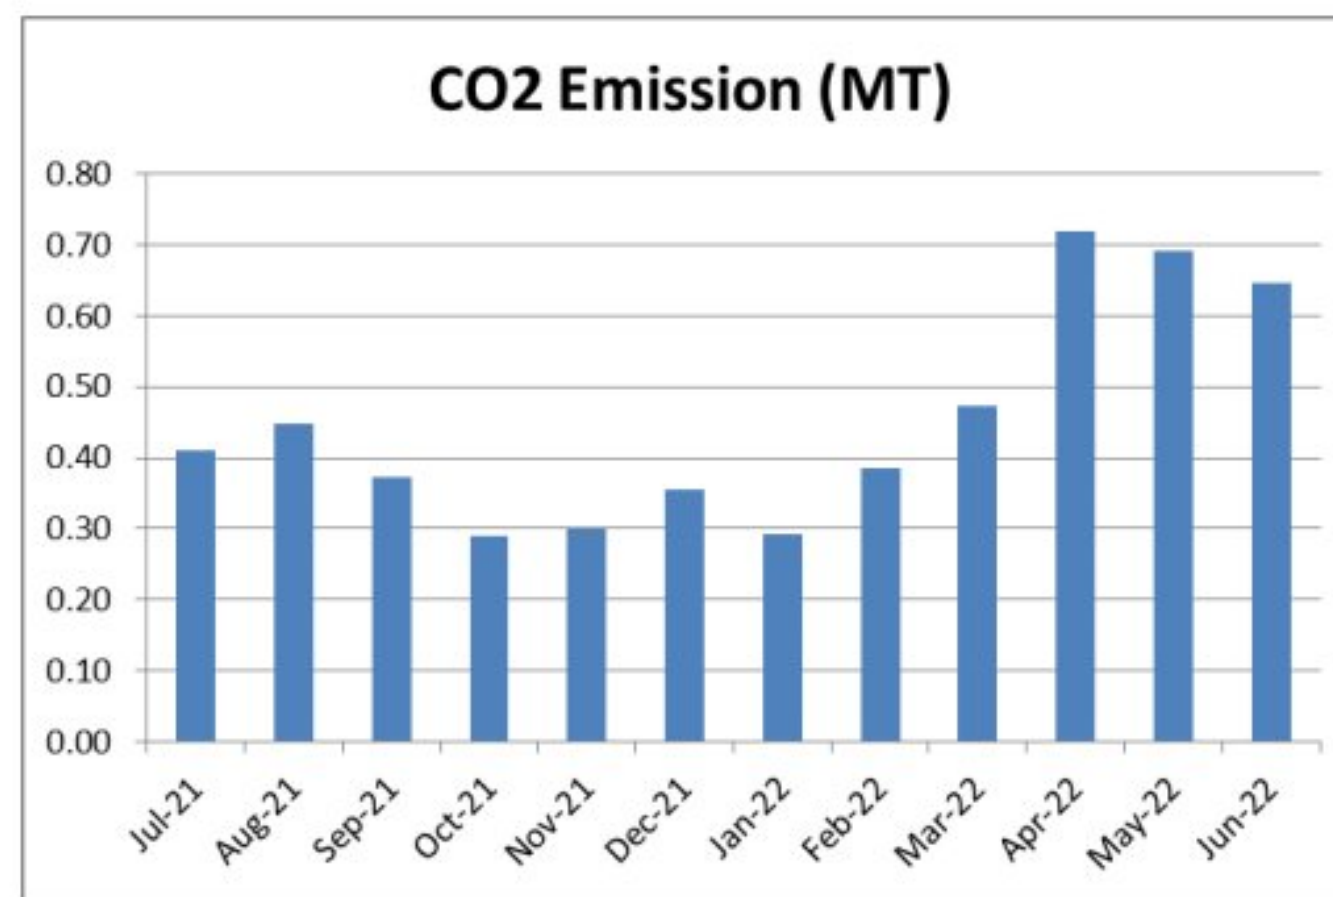


Figure 2.1: CO2 emission due to usage of electrical energy.

3.2 Study of Solid Waste Generation

The College has already installed a Bio composting Plant, wherein, the bio-degradable waste is composted & is used as fertilizer for the garden.

3.2.1 Photograph of Bio Composting Processing Tanks

3.3 Study of Liquid Waste Generation

At present the Liquid Waste generated due to day to day operations is drained off to the municipal Corporation through a pipe.

3.4 Study of e-Waste Management:

The internal communication is through emails and hence there is hardly any generation of e-Waste in the premises.

4. Study of Rain Water Harvesting

The College has already installed Rain Water Harvesting project, wherein the rain water falling on the terrace is collected and through pipes it is fed to underground Water Storage tank. This stored water is then reused for domestic purpose.

Photograph of Rain Water Harvesting Pipe:

5. Recommendations

In order to reduce the dependency on Natural resources and also in order to reduce the various pollutions arising due to the day to day operations of the College we herewith recommend following recommendations.

- Installation of Bio Gas Generator Plant instead of Bio composting Plant.
- Installation of Sewage treatment Plant to make campus a Zero Discharge campus